



MITE 71
High Pass or Low Pass
Pneumatic Selecting Relay

- Factory setting for “**HIGH**” or “**LOW**” selector is indicated by “**H**” or “**L**” stamped on body.
- Instrument input is at ports “**A**” and “**B**”. Selected signal appears at port “**C**”.

INSTRUCTIONS FOR CONVERTING SETTINGS

A. To convert unit to “**HIGH**” settings:

1. Remove 6 cap screws. Separate upper and lower cases.
2. Place the two O-rings, one on either side of diaphragm, into the inside grooves adjacent to the diaphragm. Reassemble.
3. Plug port “**C**”. Apply pressure, not over 5 psig, to port “**A**”. Tighten adjusting screw on side “**B**” until port “**B**” starts to leak. Then loosen adjusting screw slowly until leakage stops.
4. Apply not over 5 psig to port “**B**”. Tighten adjusting screw on side “**A**” until port “**A**” starts to leak. Then loosen adjusting screw slowly until leakage stops.

B. To convert unit to “**LOW**” settings:


1. Remove 6 cap screws. Separate upper and lower cases.
2. Place the two O-rings, one on either side of diaphragm, into the outside grooves away from the diaphragm. Reassemble.
3. Apply pressure, not over 5 psig, to port “**A**”. Tighten adjusting screw on side “**B**” until port “**B**” and/or “**C**” starts to leak. Then loosen adjusting screw slowly until leakage stops.
4. Apply not over 5 psig to port “**B**”. Tighten adjusting screw on side “**A**” until port “**A**” and/or “**C**” starts to leak. Then loosen adjusting screw slowly until leakage stops.

LIMITED WARRANTY & DISCLAIMER


ControlAir, Inc. products are warranted to be free from defects in materials and workmanship for a period of eighteen months from the date of sale, provided said products are used according to ControlAir, Inc. recommended usages. ControlAir, Inc.'s liability is limited to the repair, purchase price refund, or replacement in kind, at ControlAir, Inc.'s sole option, of any products proved defective. ControlAir, Inc. reserves the right to discontinue manufacture of any products or change products materials, designs or specifications without notice. Note: ControlAir does not assume responsibility for the selection, use, or maintenance of any product. Responsibility for the proper selection, use, and maintenance of any ControlAir product remains solely with the purchaser and end user.

FLOW SCHEMATIC

MITE 71 H

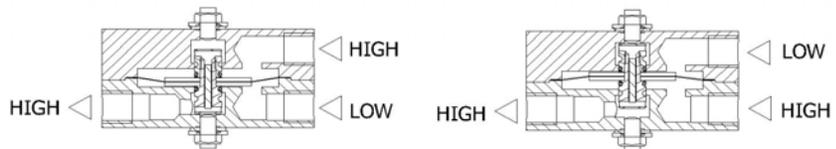

MITE 71 L

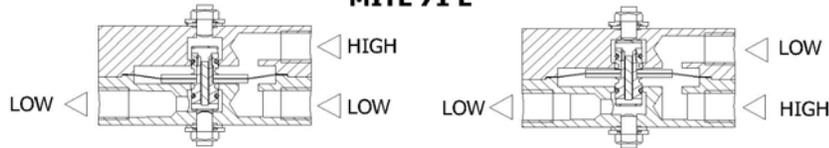

NOTES:

1. PRESSURE RATING: 100 PSIG (689 KPa)
2. TEMPERATURE RATING:
-40° F TO 180° F (-40° C TO 82.2° C)

* RECOMENDED SPARE PARTS

Parts List			
ITEM	QTY	PART NUMBER	DESCRIPTION
1	1	742-714-028	UPPER COVER
2	1	742-714-026	LOWER COVER
3	2	745-748-179	HEX SOCKET SET SCREW
4	1	742-907-002	SPOOL
5	1	742-907-004	SPOOL ADAPTOR
6	2	745-749-061	O-RING
7	1	746-735-017	PIN
8	2	747-719-024	DISC
9*	1	746-700-099	DIAPHRAGM
10*	1	746-724-024	GASKET
11	2	745-734-059	LOCK NUT
12	2	746-755-136	LOCK WASHER
13	2	745-762-067	SEALING WASHER
14	2	745-762-066	PLAIN WASHER
15	4	745-748-177	CAP SCREW 1"
16	1	736-707-059	BRACKET
17	2	745-748-178	CAP SCREW 1.25"

THIS DRAWING, AND THE INFORMATION IT DISCLOSES, ARE CONFIDENTIAL PROPERTY OF CONTROLAIR INC. AND MAY NOT BE USED, COPIED, REPRODUCED, PUBLISHED OR DISCLOSED TO OTHERS WITHOUT WRITTEN AUTHORIZATION OF CONTROLAIR INC.

TOLERANCES	REVISIONS			ControlAir Inc.		8 COLUMBIA DRIVE AMHERST, NH 03031 USA		
DECIMAL XX .01 XXX .005 XXXX .0010	NO.	DATE	BY					
FRACTIONAL ANGULAR ± 1/16	1			DIAPHRAGM OPERATION				
BREAK EDGES .01 FINISH: EZ RIMS THIRD ANGLE PROJECTION	2			MITE 71				
	3			DRAWN BY	JAG	SCALE	MATERIAL	SEE NOTES
	4			CHECKED		DATE	05-14-13	DRAWING NO.
	5			TRACED		APPROVED DAHL REF:	9071-02-0000-500	741-622-070

